


PROJECT TITLE

"CLIENT'S PROJECT" # - XX)



1. THESE DRAWINGS ARE THE SOLE PROPERTY OF THE STATE OF NORTH CAROLINA. THE USE OF THESE DRAWINGS MUST COMPLY WITH G101. STATE OF NORTH CAROLINA STANDARD FORM OF AGREEMENT BETWEEN OWNER AND DESIGNER.

2. MATERIALS, DIMENSIONS AND ALL OTHER CONDITIONS WHICH ARE NOT OTHERWISE DEFINED ON THIS DRAWING SHALL BE CONSIDERED AS HAVING THE SAME MEANING AS SIMILARLY INDICATED CONDITIONS WHICH ARE MORE FULLY DEFINED ELSEWHERE ON THIS PROJECT OR OTHER DRAWINGS OF THIS PROJECT.

3. DO NOT SCALE OFF DIMENSIONS.


BID SET
PROJECT PHASE

2307
BOOMERANG DESIGN PROJECT NUMBER

02.07.2024
DRAWING RELEASE DATE

E700

DEMOLITION SYMBOL LEGEND	
SYMBOL	DESCRIPTION
	LIGHT FIXTURE TO BE REMOVED
	LIGHT FIXTURE TO BE REMOVED
	LIGHT FIXTURE TO BE REMOVED
	LIGHT FIXTURE TO BE REMOVED
	CANOPY LIGHT FIXTURE TO BE REMOVED
	EXIT LIGHT FIXTURE TO BE REMOVED
	CONDUIT/WIRING TO BE REMOVED
WM	WIREMOLD TO BE REMOVED
	RECEPTACLE TO BE REMOVED
	WIRELESS ACCESS POINT TO BE REMOVED
	LOUD SPEAKER TO BE REMOVED
	LOUD SPEAKER TO BE REMOVED
	TELEVISION OUTLET TO BE REMOVED
	PANEL BOARD TO BE REMOVED
	FIRE ALARM PULL STATION TO BE REMOVED
	FIRE ALARM HEAT DETECTOR TO BE REMOVED
	OVERHEAD PROJECTOR OUTLETS TO BE REMOVED
	JUNCTION BOX TO BE REMOVED

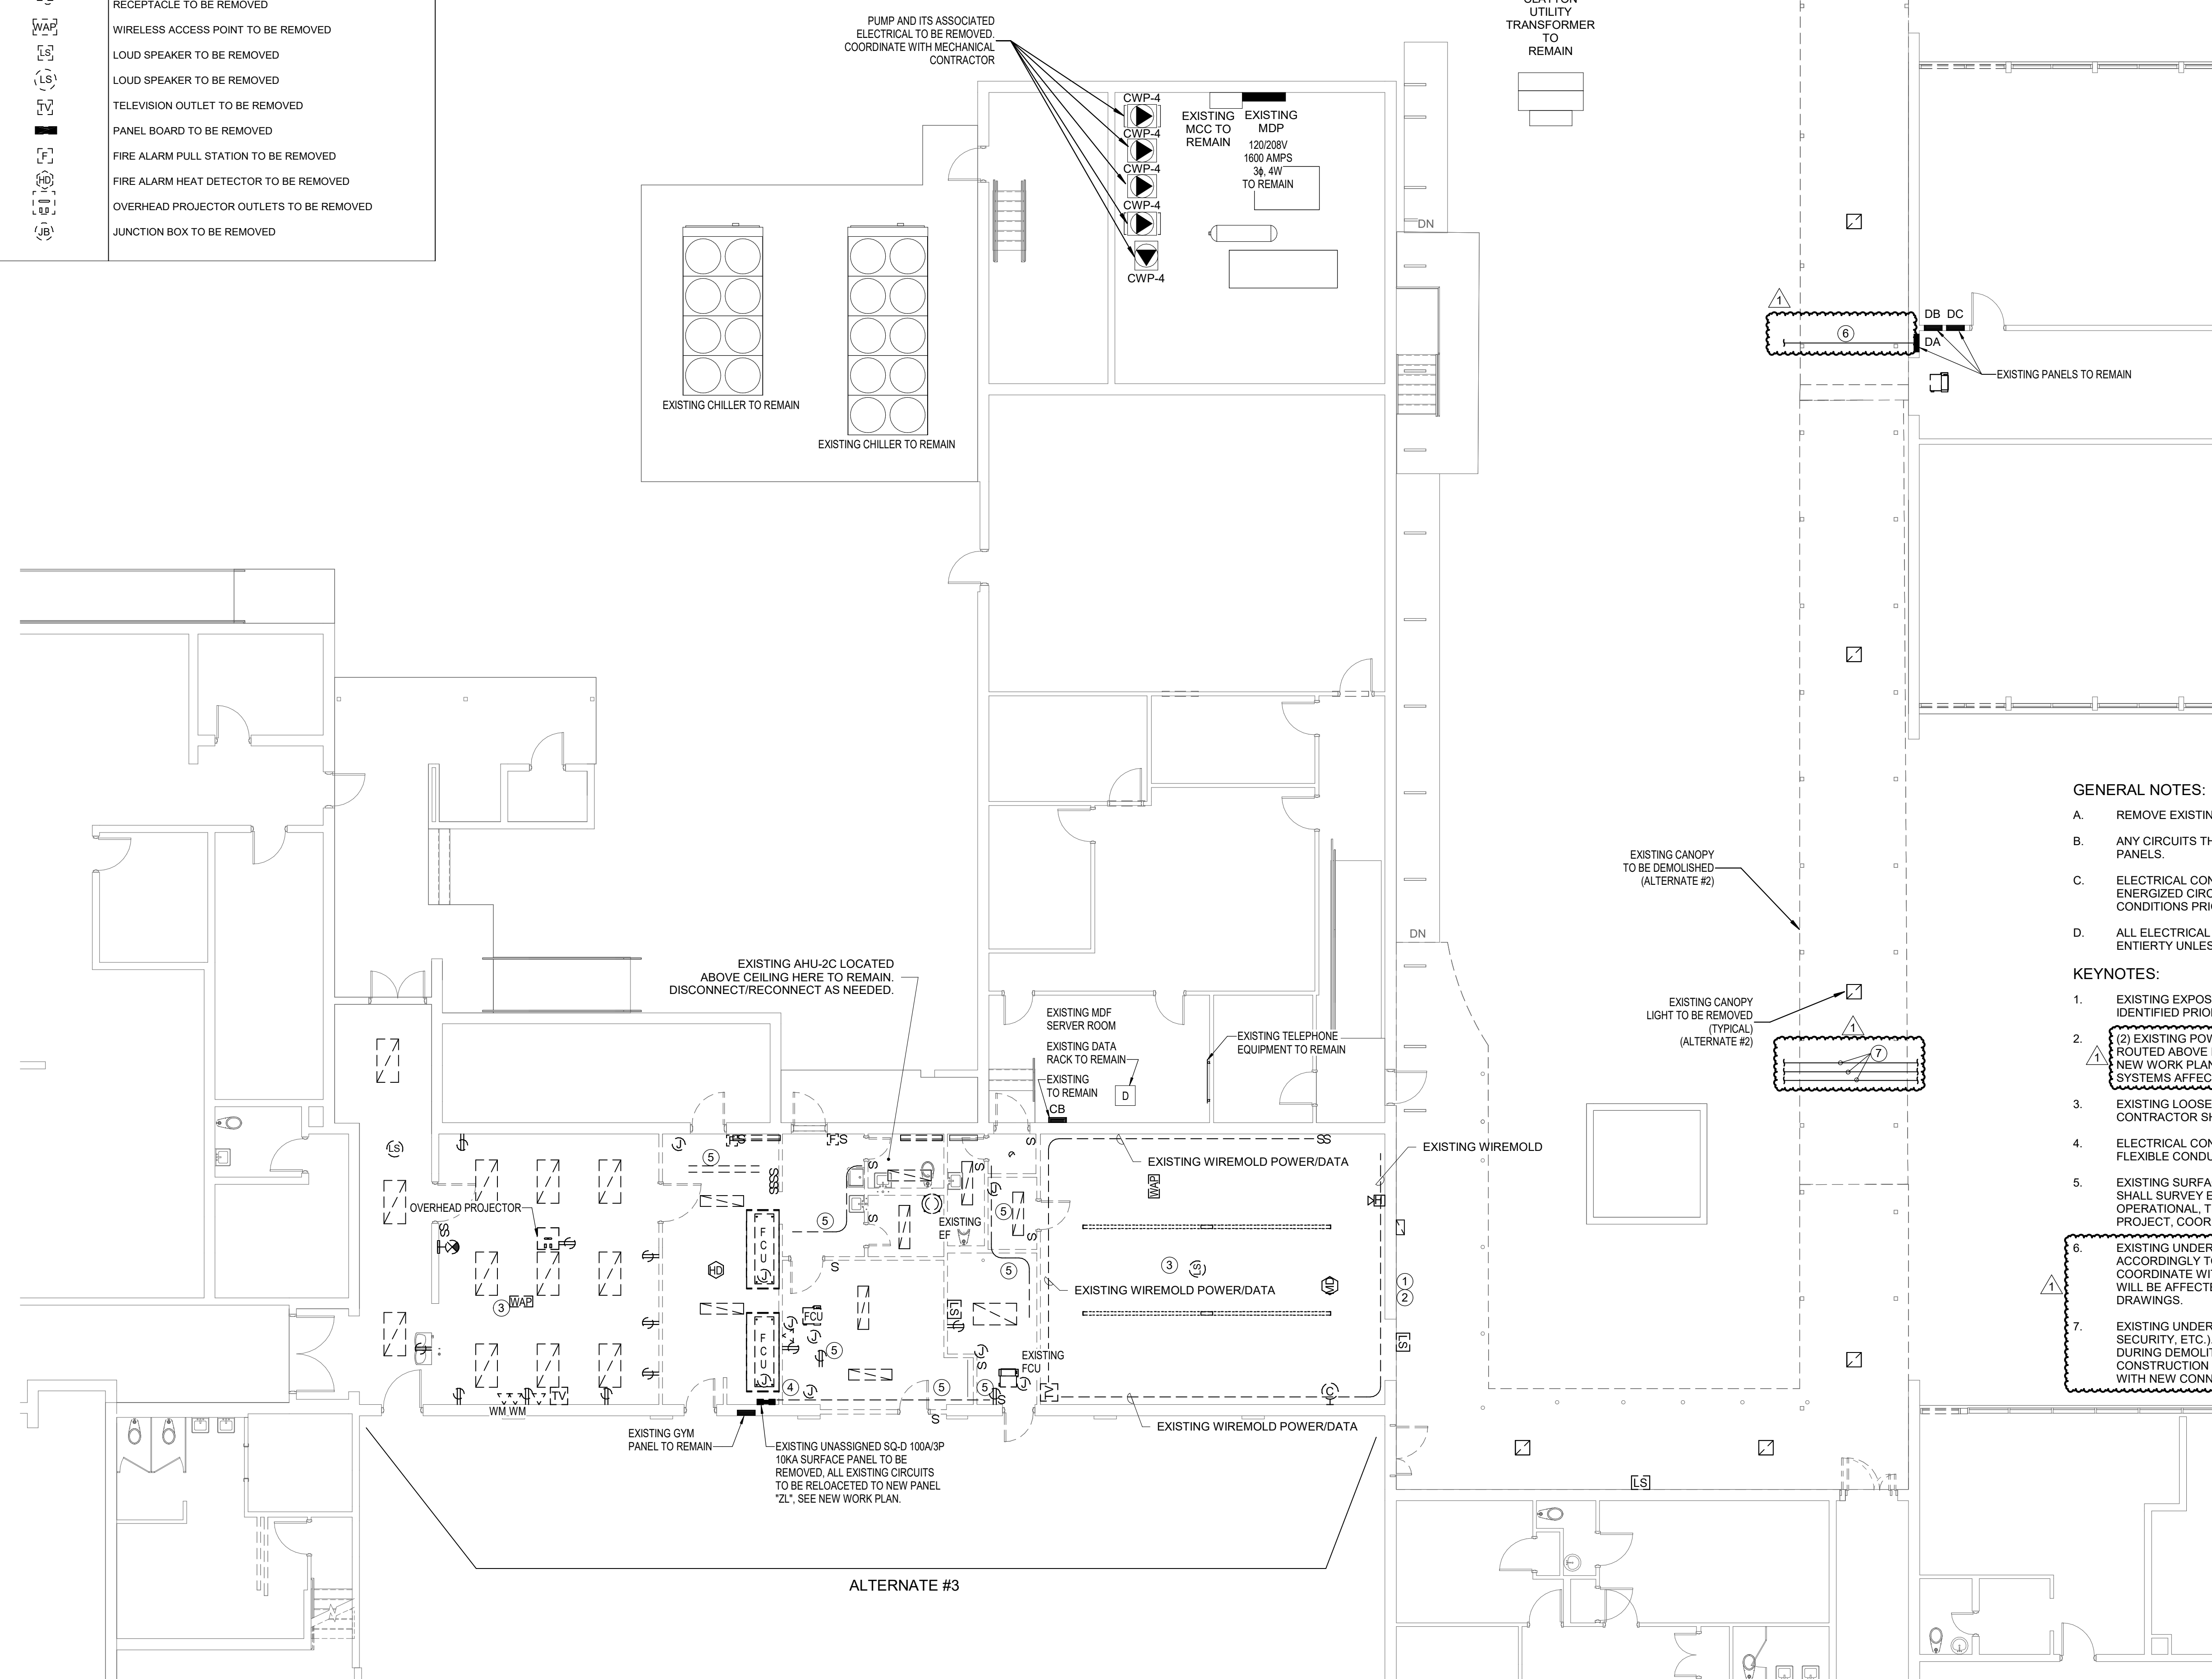

GENERAL NOTES:

- A. REMOVE EXISTING WIREMOLD IN AREAS AFFECTED BY RENOVATION.
- B. ANY CIRCUITS THAT BECOME UNUSED SHALL BE IDENTIFIED AS SPARE AT PANELS.
- C. ELECTRICAL CONTRACTOR SHALL TAKE CAUTION WHEN WORKING ON ENERGIZED CIRCUITS. CONTRACTOR SHALL SURVEY EXISTING CONDITIONS PRIOR TO PERFORMING.
- D. ALL ELECTRICAL ITEMS SHOWN AS DASHED SHALL BE REMOVED IN THEIR ENTIRETY UNLESS OTHERWISE NOTED.

KEYNOTES:

1. EXISTING EXPOSED WIRING ON TOP OF EXISTING CANOPY SHALL BE IDENTIFIED PRIOR TO REMOVAL/RELOCATION. REFER TO NEW WORK PLAN.
2. EXISTING POWER AND LIGHTING (A) AND (B) SHALL BE IDENTIFIED AND ROUTED ABOVE EXISTING CANOPY. RELOCATE AND RESUPPORT. REFER TO NEW WORK PLAN. CONTRACTOR SHALL FIELD VERIFY CIRCUITS AND ITEMS AFFECTED BY RELOCATION. CONTRACTOR SHALL BE RESPONSIBLE TO LOOSE WIRE AND RELOCATE. CONTRACTOR SHALL SURVEY PRIOR TO BID.
3. ELECTRICAL CONTRACTOR SHALL RESUPPORT UNSUPPORTED EXISTING FLEXIBLE CONDUIT.
4. EXISTING SURFACE MOUNTED CONDUITS ON CEILING/WALLS. CONTRACTOR SHALL SURVEY EXISTING CONDITION. IF CONDUITS AND WIRING ARE OPERATIONAL, THEN CONTRACTOR SHALL REROUTE CONCEALED AS PART OF PROJECT. COORDINATE TO AVOID CLOSELY WITH ARCHITECT.
5. EXISTING UNDERGROUND FEEDER SHALL BE FIELD VERIFIED AND IDENTIFIED ACCORDINGLY TO AVOID CLOSELY WITH ARCHITECT. CONTRACTOR SHALL COORDINATE WITH CONSTRUCTION MANAGER IN DETERMINING IF FEEDER WILL BE AFFECTED WITH NEW CONNECTOR FOOTINGS. REFER TO CIVIL DESIGNER.
6. EXISTING UNDERGROUND COMMUNICATIONS CONDUITS (i.e. FIBER, PAGING, SECURITY, ETC.). FIELD VERIFY AND IDENTIFY CONDUITS/CABLING AVOID DURING DEMOLITION. CONTRACTOR SHALL COORDINATE WITH CONSTRUCTION MANAGER IN DETERMINING IF CONDUITS WILL BE AFFECTED WITH NEW CONNECTOR FOOTINGS. REFER TO CIVIL DRAWINGS.

1 ALT. 2 CONNECTOR ADDITION & ALT. 3 CORRIDOR RENOVATION - DEMOLITION

2/19/2024 3:33:06 PM