


GENERAL NOTES:


- MECHANICAL AND BAS CONTRACTORS SHALL REVIEW THE FINAL CASEWORK AND FFE DRAWINGS AND IDENTIFY POTENTIAL CONFLICTS WITH THERMOSTAT AND SENSOR LOCATIONS PRIOR TO ROUGH-IN. NOTIFY ARCHITECT AND ENGINEER OF CONFLICTS AND DISCREPANCIES.
- ALL VALVES SHALL BE INSTALLED SUCH THAT THEY ARE EASILY ACCESSIBLE FROM BELOW THE CEILING. COORDINATE WITH OTHER TRADES, INCLUDING FIRE PROTECTION AND ELECTRICAL.
- PIPING RUNOUTS TO BLOWER FAN COIL UNITS SHALL NOT IMPEDE INTO CLEARANCE SPACE REQUIRED FOR SERVICING OR CONTROLS ENCLOSURE. PROVIDE FINAL CONNECTIONS PER DETAILS.
- PROVIDE 3/4" CONDENSATE WITH TRAP AT EACH UNIT AND ROUTE TO NEAREST FLOOR DRAIN. TERMINATE WITH AIR GAP. REFER TO PLUMBING PLANS FOR EXACT LOCATIONS OF FLOOR DRAINS. ROUTE PIPING TO PREVENT TRIP HAZARD.
- UNLESS OTHERWISE NOTED ALL HHWS AND HHWR BRANCH LINES SERVING FCU'S SHALL BE 3/4" AND CHWS AND CHWR BRANCH LINES SERVING FCU'S SHALL BE 1".

KEYNOTES:

- PROVIDE PRESSURE DIFFERENTIAL SENSOR.

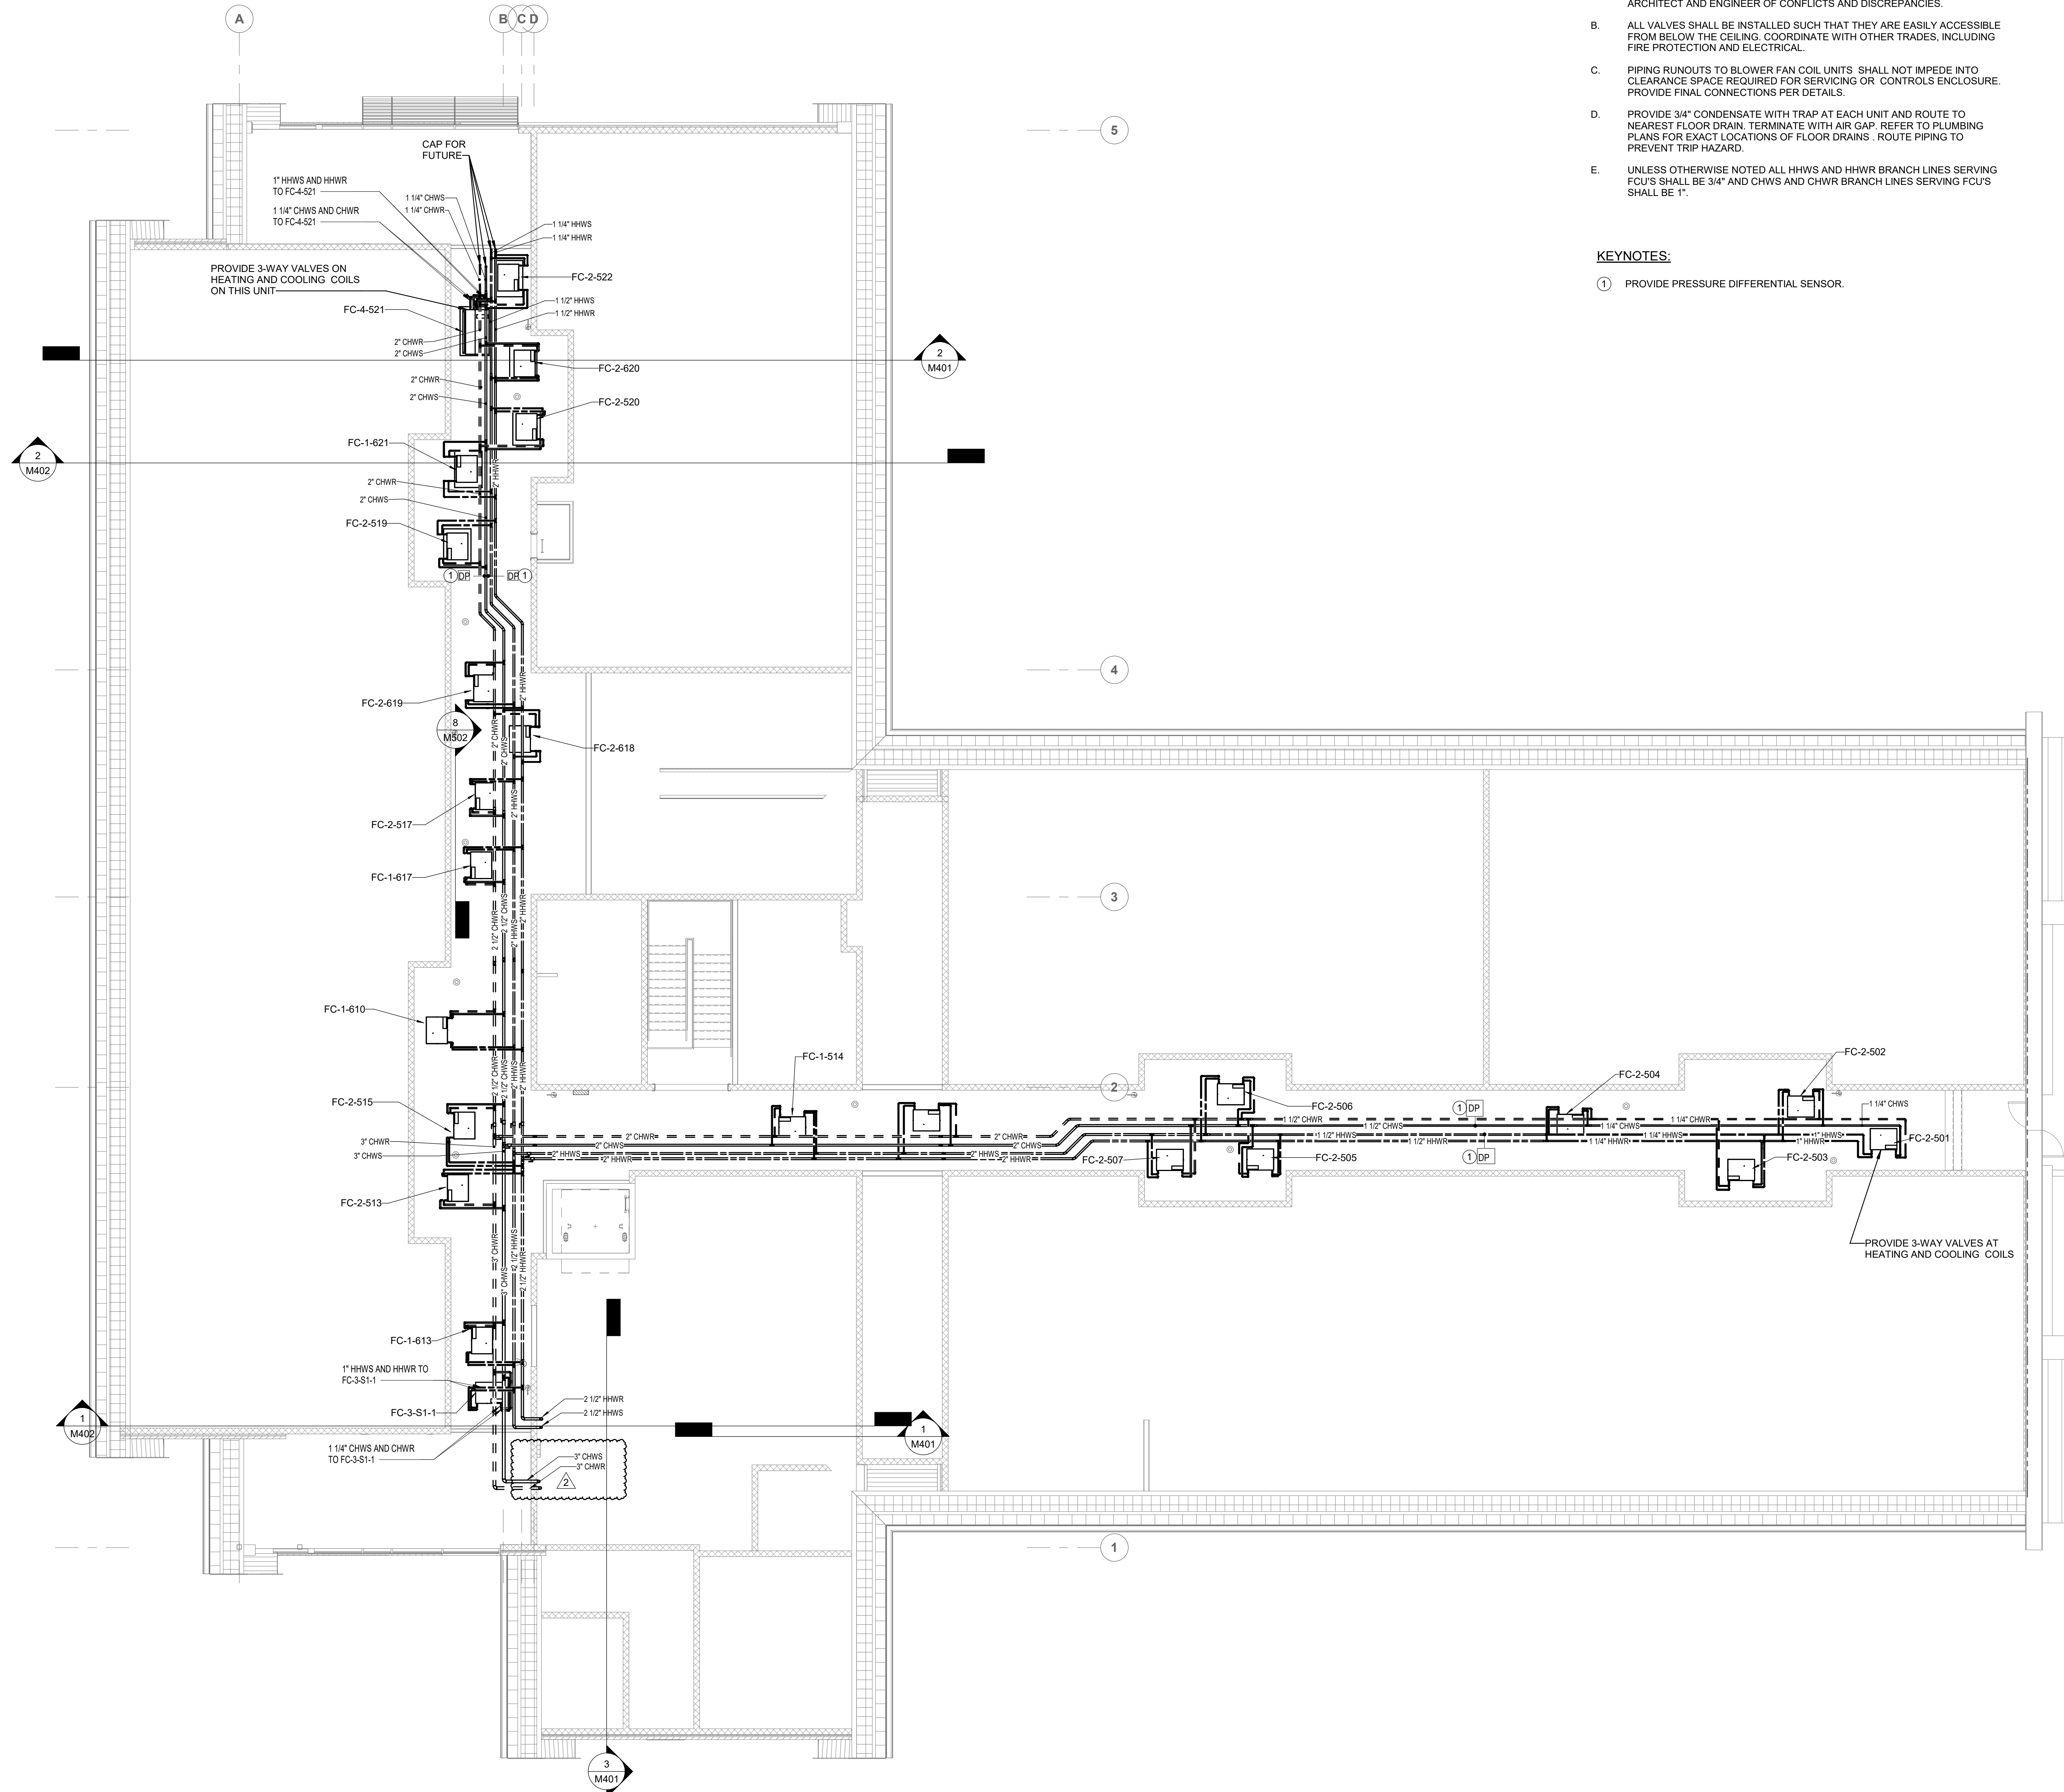

1 MEZZANING PIPING PLAN  
1/8" = 1'-0"



- THESE DRAWINGS ARE THE SOLE PROPERTY OF THE STATE OF NORTH CAROLINA. THE USE OF THESE DRAWINGS MUST COMPLY WITH GOOD STATE OF NORTH CAROLINA STANDARD FORM OF AGREEMENT BETWEEN OWNER AND DESIGNER.
- MATERIALS, DIMENSIONS AND ALL OTHER CONDITIONS WHICH ARE NOT OTHERWISE SPECIFIED ON THIS DRAWING SHALL BE CONSIDERED AS HAVING THE SAME MEANING AS SIMILARLY INDICATED CONDITIONS WHICH ARE MORE FULLY DEFINED ELSEWHERE ON THIS PROJECT OR OTHER DRAWINGS OF THIS PROJECT.
- DO NOT SCALE OFF DIMENSIONS.

NO.	DATE	DESCRIPTION
2	02/26/2024	ADDENDUM 02